Flam#ff-P50

SUPER POWDER 6KG - FIRE EXTINGUISHER

FIRE RATING: 43A - 233B











EN3



FM-P50/6SP Super Powder





Super powder is a combination of Mono-ammonium phosphate and ammonium sulphate.

On Class A fires the particles fuse and swell to form a barrier which excludes oxygen and prevents re-ignition. On Class B fires the powder interferes with the chemical reactions, thus the flame ceases to exist.

The powder is nonconductive.

Super powder will extinguish Class A (carbonaceous) fires, Class B (flammable liquid) fires and Class C (flammable gas) fires.

Features

- · 10 year operational corrosion guarantee
- 10 year quality assurance on material defects and workmanship
- · 20 year life cycle
- · No service contract required
- Requires only one manufacturer overhaul at 10 years
- A yearly visual maintenance inspection, checking indicators with the magnet
- Recyclable
- Super strength Aramid (Kevlar®) type material yarn
- · Lightweight for ease of operation
- · Kitemark, PED and EN3 approved
- Manufacturer ensures safe disposal of contents when required
- UV protection of the outer casing
- QA laser serial number on outer casing
- Operating valve nickel plated brass
- World recognised patented design
- Main approvals and certifications as below





TECHNICAL SPECIFICATION											
Model	Capacity (Kg)	Fire Rating	Full Weight (Kgs)	Temp Range	Operating Pressure (Bar) @ 20°C	Discharge Duration (Secs)	Discharge Range (M)	Diameter (mm)	Height (mm)		
FM-P50/6SP	6	43A/233B	8.5	-20° to + 60°C	12	20	5+	178	570		

SPECIFICATIONS					
Operating Pressure @ 20°C	12bar				
Test Pressure (PT)	22bar				
Maximum Allowable Pressure (PS)	15.38bar				
Minimum Burst Pressure	55bar				
Cylinder Material	HDPE with Aramid Winding (Kevlan)				
Operating Head Material	Brass C3771 - Nickel Plated				
Hose and Nozzle	Hose - EPDM Synthetic Rubber				

The extinguisher maintenance programme is a simple process which staff members can easily carry out.

If an indicator is in the RED segment return to manufacturer or appointed distributor.

Remove any dust with a clean cloth. Turn upside down to inspect base and locate testing magnet.

Check date is within 10 year operational lifespan (colour coded stud in base gives year of manufacture (F). At 10 years return to manufacturer or distributor for manufacturers overhaul to extend the lifespan by a further 10 years.


Check the tamper seal is in place (E). If tamper seal is missing, contact manufacturer or distributor.

Check both indicators with a magnet to confirm operation (G). Moving magnet from side to side needle should move then return to GREEN segment. Return magnet to base.

Record yearly inspection date into logbook and mark extinguisher body with permanent marker pen.

INSTALLATION DATE							
Examiners Signature							
ADIF							
MPLL							

COMPONENT PARTS						
Item	Description	Part No.				
Α	Headcap Assembly	P50-HC-ASS				
В	Hose Assembly and Nozzle	P50-HO-ASS				
С	Oetiker Clip	BRO540 & 541				
D	Transport Bracket and Strap	P50-TB6				
-	(ABC40) 6kg Power Refill	P50-DP6				
-	Wall Bracket Normal	P506-BRACKET				
-	Wall Over Bracket	P50 OVER- BRACKET				

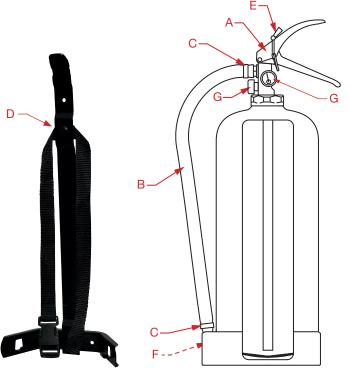

Please contact our authorized distributor or agent



FLAMOFF INDUSTRIES (M) SDN. BHD.No 51 Jalan Villaraya 2/4 Crest Hill Industrial Park 2 43500 Semenyih Selangor Malaysia